


1 LIGHTING PLAN - CLASSROOM BLDG. "A"
E1.01 1/8" = 1'-0"

LIGHTING FIXTURE SCHEDULE		
TYPE	MANUFACTURER CAT. NO.	DESCRIPTION
F1	COOPER 26C8-332A125-UNV-EB82-PAF	2' x 4' LENSED FLUORESCENT TROFFER WITH (3) F32/835 T8 LAMPS, AND ELECTRONIC BALLASTS FOR DUAL LAMP SWITCHING.
F1E		SAME AS TYPE "F1" EXCEPT PROVIDE BODINE REDITEST (NICKEL CADMIUM BATTERY) SYSTEM.
F1A		SAME AS TYPE "F1" EXCEPT SINGLE BALLAST
F2	COOPER 26C8-232A125-UNV-EB81-PAF	2' x 4' LENSED FLUORESCENT TROFFER WITH (2) F32/835, T8 LAMPS, AND ELECTRONIC BALLAST
F3	CRAFTMADE "CLX" SERIES (WHITE FINISH)	CEILING FAN, 5 BLADES, WHITE, 52" SIZE OR APPROVED EQUAL.
F4	COOPER FSRC-64A-UNV-WHT-EB81	4' SURFACE MOUNT FLUORESCENT STRIP, WHITE, WITH CLEAR PRISMATIC POLYCARBONATE LENS, WITH (2) 32W LAMPS, ELECTRONIC BALLAST
F5	COOPER SS-217-UNV-EB81-U	2' FLUORESCENT STRIP, TWO (2) F17T8 LAMPS, 120V, ELECTRONIC BALLAST.
F6	COOPER SS-232-UNV-EB81-U	2' FLUORESCENT STRIP, TWO (2) F32T8 LAMPS, ELECTRONIC BALLAST, WIREGUARD
F7E	COOPER C17032EP/7000LI/REMOTE EM BALLAST	RECESSED COMPACT FLUORESCENT WITH (1) 26W QUAD 4-PIN LAMP AND ELECTRONIC BALLAST. PROVIDE BODINE REDITEST (NICKEL CADMIUM BATTERY) SYSTEM. VERIFY FINISH WITH ARCHITECT.
F8E	COOPER TL110A-PL-84-120/277-EM	IMPACT FLUORESCENT WALLPACK, WITH TWO (2) 42W LAMPS, ELECTRONIC BALLAST WITH AN EMERGENCY BALLAST, VERIFY FINISH WITH ARCHITECT
F9	COOPER 2RDI-332RP-UNV-EB82-U	2' x 4' RECESSED DIRECT/INDIRECT FLUORESCENT FIXTURE WITH (3) F32/835 T8 LAMPS, AND ELECTRONIC BALLASTS FOR DUAL LAMP SWITCHING.
F9E	COOPER 2RDI-332RP-UNV-EB82-EM	SAME AS TYPE "F9" EXCEPT PROVIDE BODINE REDITEST (NICKEL CADMIUM BATTERY) SYSTEM.
EX	COOPER LPX70RWHDH	EXIT LIGHT WITH BATTERY BACK-UP
EM	COOPER CC4WH	DUAL HEAD EMERGENCY FIXTURE WITH BATTERY BACK-UP

ELECTRICAL KEY NOTES

- ① UNLESS NOTED OTHERWISE, EXTERIOR FIXTURES SHALL BE CONTROLLED THROUGH THE LIGHTING CONTROL PANEL.
- ② SEE SPECIFICATIONS FOR LIGHTING CONTROL SYSTEM. ALL LIGHTING HOMERUNS SHALL BE ROUTED THROUGH THE LIGHTING CONTROL PANEL "LC1". UNLESS SPECIFICALLY INDICATED OTHERWISE, ALL LIGHT SWITCHES ON THIS PROJECT ARE SPECIALTY SWITCHES. SEE SPECIFICATIONS FOR DETAILS.
- ③ THE TYPE "F4" AND "F6" FIXTURES SHALL BE ADJUSTED AS NECESSARY TO AVOID CONFLICTS WITH THE MECHANICAL EQUIPMENT.
- ④ 3/4" CONDUIT WITH THREE (3) #10 AWG CONDUCTORS & #10 AWG GROUND.
- ⑤ 3/4" CONDUIT WITH TWO (2) #10 AWG CONDUCTORS & #10 AWG GROUND.

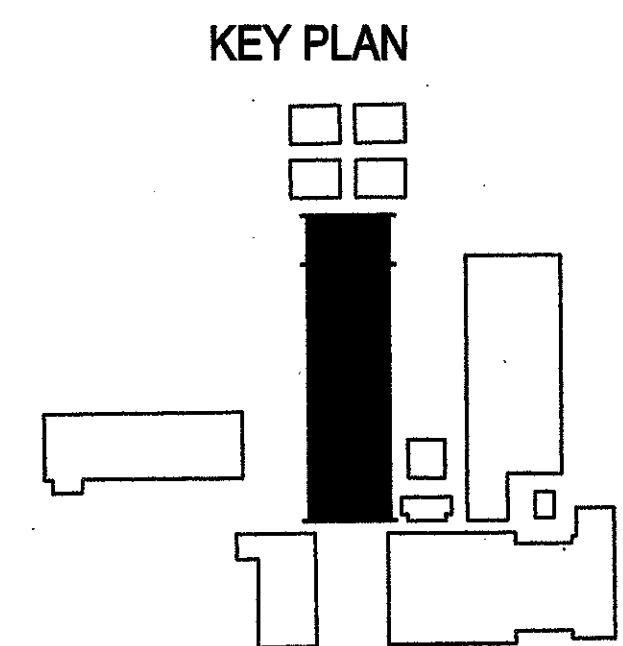

drake engineering
36 MARK SMITH DR. MANDEVILLE, LA 70471 (504) 382-3038 PROJECT No. 0552408

VergesRome
Architects
320 N. Carrollton Avenue, Suite 100
New Orleans, Louisiana 70119
t. 504.488.7739 f. 504.488.7743
www.VergesRome.com
© copyright 2009

STATE OF LOUISIANA
RYAN C. ORGERON
Reg. No. 29405
Registered Professional
05/10/09

RENOVATIONS AND ADDITION
 TO CLASSROOM BUILDINGS
 FOLSOM JR. HIGH SCHOOL
 ST. TAMMANY PARISH SCHOOL BOARD
 FOLSOM, LOUISIANA
 83065 HAY HOLLOW ROAD

DATE ISSUED: 10 JUNE 2009
 REVISED:
 REVISED:
 REVISED:
 REVISED:
 DRAWN BY: TPD, MBK
 CHECKED BY: RCO
 PHASE:
 CONSTRUCTION DOCUMENTS

08060
 TITLE:
 LIGHTING PLAN
 CLASSROOM BLDG. "A"
 SHEET:
 E1.01