

DIRECTORY		Ckt. No.	BKR. AMPS	L1 L2 L3		BKR. AMPS	Ckt. No.	DIRECTORY	
RTU-1	1	110				300	2	RTU-2	
	3						4		
	5						6		
RTU-3	7	100				80	8	RTU-4	
	9						10		
	11						12		
PANEL AC1	13	200				200	14	PANEL P1	
	15						16		
	17						18		
PANEL HE	19	200				200	20	PANEL L1	
	21						22		
	23						24		
	25						26		
	27						28		
	29						30		
	31						32		
	33						34		
	35						36		
	37						38		
	39						40		
	41						42		

VOLTAGE: 120/208V, 3Ø, 4 WIRE MAIN BUS: 1200A
 MAIN BREAKER: 800A MAIN LUGS ONLY
 MOUNTING: SURFACE 42,000 A.I.C.
 NOTE: NEMA 3R

PANEL NO. DPA
 Loc. ELECTRICAL ROOM. 109

DIRECTORY		Ckt. No.	BKR. AMPS	L1 L2 L3		BKR. AMPS	Ckt. No.	DIRECTORY	
ELECTRIC RANGE	1	20				20	2	ELECTRIC RANGE	
RECEPTACLES	3	20				20	4	RECEPTACLES	
ELECTRIC RANGE	5	20				20	6	ELECTRIC RANGE	
INFRARED WATER CLOSET SENSORS	7	20				20	8	RECEPTACLES	
DRYER	9	20				20	10	SEWING MACHINES	
EWC	11	20				20	12	SEWING MACHINES	
WASHING MACHINE	13	20				20	14	DISHWASHER	
RECEPTACLES	15	20				20	16	MICROWAVE	
RECEPTACLES	17	20				20	18	RECEPTACLES	
RECEPTACLES	19	20				20	20	RECEPTACLES	
MICROWAVE	21	20				20	22	RECEPTACLES	
REFRIGERATOR	23	20				20	24	REFRIGERATOR	
RECEPTACLES	25	20				20	26	RANGE HOOD	
RECEPTACLES	27	20				20	28		
RECEPTACLES	29	20				20	30	RECEPTACLES	
RECEPTACLES	31	20				20	32	RECEPTACLES	
RECEPTACLES	33	20				20	34	RECEPTACLES	
RECEPTACLES	35	20				20	36	RECEPTACLES	
RECEPTACLES	37	20				20	38		
RECEPTACLES	39	20				20	40		
RECEPTACLES	41	20				20	42		

VOLTAGE: 120/208V, 3Ø, 4 WIRE MAIN BUS: 225A
 MAIN BREAKER: 225A MAIN LUGS ONLY
 MOUNTING: SURFACE 22,000 A.I.C.
 NOTE: NEMA 1, FEED THROUGH LUGS FOR FUTURE PANEL SEC.2

PANEL NO. HE
 Loc. ELECTRICAL ROOM. 109

DIRECTORY		Ckt. No.	BKR. AMPS	L1 L2 L3		BKR. AMPS	Ckt. No.	DIRECTORY	
LIGHTS	1	20				20	2	LIGHTS	
LIGHTS	3	20				20	4	LIGHTS	
LIGHTS	5	20				20	6	LIGHTS	
LIGHTS	7	20				20	8	LIGHTS	
LIGHTS	9	20				20	10	LIGHTS	
LIGHTS	11	20				20	12	LIGHTS	
FANS	13	20				20	14	FANS	
FANS	15	20				20	16	FANS	
FANS	17	20				20	18	SPARE	
SPARE	19	20				20	20	SPARE	
SPARE	21	20				20	22	SPARE	
SPARE	23	20				20	24	SPARE	
SPARE	25	20				20	26	SPARE	
SPARE	27	20				20	28	SPARE	
SPARE	29	20				20	30	SPARE	
SPARE	31	20				20	32	SPARE	
SPARE	33	20				20	34	SPARE	
SPARE	35	20				20	36	SPARE	
SPARE	37	20				20	38	SPARE	
SPARE	39	20				20	40	SPARE	
EXTERIOR LIGHTS	41	20				20	42	EXTERIOR LIGHTS	

VOLTAGE: 120/208V, 3Ø, 4 WIRE MAIN BUS: 225A
 MAIN BREAKER: 225A MAIN LUGS ONLY
 MOUNTING: SURFACE 22,000 A.I.C.
 NOTE: NEMA 1

PANEL NO. L1
 Loc. ELECTRICAL ROOM. 109

DIRECTORY		Ckt. No.	BKR. AMPS	L1 L2 L3		BKR. AMPS	Ckt. No.	DIRECTORY	
ELECTRIC HEATER-1	1	30				30	2	ELECTRIC HEATER-2	
	3						4		
	5						6		
WH-A	7	40				15	8	WH-B	
	9						10		
PTAC-A	11	30				30	12	PTAC-A	
	13						14		
PTAC-A	15	30				30	16	PTAC-A	
	17						18		
PTAC-A	19	30				30	20	PTAC-A	
	21						22		
PTAC-A	23	30				30	24	PTAC-A	
	25						26		
PTAC-A	27	30				30	28	PTAC-A	
	29						30		
PTAC-A	31	30				30	32	PTAC-A	
	33						34		
PTAC-A	35	30				30	36	PTAC-A	
	37						38		
	39						40		
	41						42		

VOLTAGE: 120/208V, 3Ø, 4 WIRE MAIN BUS: 225A
 MAIN BREAKER: MAIN LUGS ONLY
 MOUNTING: SURFACE 22,000 A.I.C.
 NOTE: NEMA 1

PANEL NO. AC1
 Loc. ELECTRICAL ROOM. 109

DIRECTORY		Ckt. No.	BKR. AMPS	L1 L2 L3		BKR. AMPS	Ckt. No.	DIRECTORY	
RECEPTACLES	1	20				20	2	RECEPTACLES	
RECEPTACLES	3	20				20	4	RECEPTACLES	
RECEPTACLES	5	20				20	6	RECEPTACLES	
INFRARED WATER CLOSET SENSORS	7	20				20	8	RECEPTACLES	
RECEPTACLES	9	20				20	10	RECEPTACLES	
EWC	11	20				20	12	RECEPTACLES	
RECEPTACLES	13	20				20	14	RECEPTACLES	
RECEPTACLES	15	20				20	16	RECEPTACLES	
RECEPTACLES	17	20				20	18	RECEPTACLES	
RECEPTACLES	19	20				20	20	RECEPTACLES	
RECEPTACLES	21	20				20	22	RECEPTACLES	
RECEPTACLES	23	20				20	24	RECEPTACLES	
RECEPTACLES	25	20				20	26	RECEPTACLES	
RECEPTACLES	27	20				20	28	RECEPTACLES	
RECEPTACLES	29	20				20	30	RECEPTACLES	
RECEPTACLES	31	20				20	32	RECEPTACLES	
RECEPTACLES	33	20				20	34	RECEPTACLES	
RECEPTACLES	35	20				20	36	RECEPTACLES	
RECEPTACLES	37	20				20	38	RECEPTACLES	
RECEPTACLES	39	20				20	40	HAND DRYER	
RECEPTACLES	41	20				20	42	HAND DRYER	

VOLTAGE: 120/208V, 3Ø, 4 WIRE MAIN BUS: 225A
 MAIN BREAKER: 225A MAIN LUGS ONLY
 MOUNTING: SURFACE 22,000 A.I.C.
 NOTE: NEMA 1, FEED THROUGH LUGS FOR FUTURE PANEL SEC.2

PANEL NO. P1
 Loc. ELECTRICAL ROOM. 109


DIRECTORY		Ckt. No.	BKR. AMPS	L1 L2 L3		BKR. AMPS	Ckt. No.	DIRECTORY	
RECEPTACLES	43	20				20	44	SPARE	
RECEPTACLES	45	20				20	46	HAND DRYER	
RECEPTACLES	47	20				20	48	HAND DRYER	
RECEPTACLES	49	20				20	50	RECEPTACLES	
RECEPTACLES	51	20				20	52	RECEPTACLES	
IDF CABINET	53	20				20	54	RECEPTACLES	
FIRE ALARM PANEL	55	20				20	56	RECEPTACLES	
SPECIAL SYSTEMS BACKBOARD	57	20				20	58	RECEPTACLES	
SPECIAL SYSTEMS BACKBOARD	59	20				20	60	RECEPTACLES	
	61	20				20	62	RECEPTACLES	
	63	20				20	64		
	65	20				20	66		
	67	20				20	68	SPARE	
	69	20				20	70	SPARE	
	71	20				20	72	SPARE	
SPARE	73	20				20	74	SPARE	
SPARE	75	20				20	76	SPARE	
SPARE	77	20				20	78	SPARE	
SPARE	79	20				20	80	SPARE	
SPARE	81	20				20	82	SPARE	
SPARE	83	20				20	84	SPARE	

VOLTAGE: 120/208V, 3Ø, 4 WIRE MAIN BUS: 225A
 MAIN BREAKER: 225A MAIN LUGS ONLY
 MOUNTING: SURFACE 22,000 A.I.C.
 NOTE: PROVIDE TVSS IN PANEL PP2 PER SPECIFICATIONS

PANEL NO. P1
 Loc. ELECTRICAL ROOM. 109



VergesRome
 Architects
 320 N. Carrollton Avenue, Suite 100
 New Orleans, Louisiana 70119
 T. 504.488.7739 F. 504.488.7743
 www.VergesRome.com
 © copyright 2009

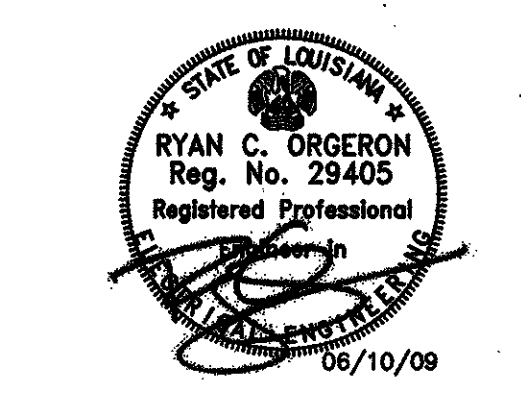

RENOVATIONS AND ADDITION
 TO CLASSROOM BUILDINGS
 FOLSOM JR. HIGH SCHOOL
 ST. TAMMANY PARISH SCHOOL BOARD
 FOLSOM, LOUISIANA
 83065 HAY HOLLOW ROAD

DATE ISSUED: 10 JUNE 2009
 REVISED:
 REVISED:
 REVISED:
 REVISED:
 DRAWN BY: TPD, MBK
 CHECKED BY: ROC
 PHASE: CONSTRUCTION DOCUMENTS
 08060
 TITLE: PANEL SCHEDULES
 SHEET: E3.02