

**GENERAL NOTES:**

- A. ALL CONVENIENCE OUTLETS, (SIMPLEX, DUPLEX, QUADRAPLEX) WHERE WALL MOUNTED VERTICALLY, SHALL BE INSTALLED WITH GROUNDING POINT DOWN. WHERE WALL MOUNTED HORIZONTALLY, THE NEUTRAL SPADE WILL BE UP.
- B. ALL 125V, SINGLE PHASE, 15 AND 20 AMP. RECEPTACLE OUTLETS THAT ARE USED AS TEMPORARY POWER DURING CONSTRUCTION BY PERSONNEL SHALL HAVE GFI PROTECTION FOR PERSONNEL.
- C. ALL JUNCTION BOXES SHALL BE CLEARLY MARKED WITH INDELEBIL MARKER ON THE COVER FACE WITH THE CIRCUIT NUMBER AND PANEL NAME FOR ALL CIRCUITS WITHIN RESPECTIVE BOX.
- D. CONTRACTOR TO REMOVE TRIM COVER PLATES, FIXTURES, ETC. FROM WALLS AND CEILINGS AS REQUIRED TO ACCOMMODATE PAINTING, WALL FINISHING, ETC., THROUGHOUT AREAS OF WORK.
- E. ALL CABLING, RACEWAYS, ETC. INSTALLED CONCEALED AND EXPOSED SHALL BE BUNDLED, STRAPPED AND SUPPORTED PROPERLY. ALL COMMUNICATION CABLING SHALL BE INDEPENDENTLY SUPPORTED FROM THE STRUCTURE ABOVE.
- F. ALL PENETRATIONS, SLEEVES, OPENINGS, ETC., THROUGH SMOKE OR FIRE RATED WALLS, CEILINGS, OR FLOORS SHALL BE PROPERLY CAULKED WITH AN APPROVED FIRE CAULKING MATERIAL, APPROVED BY ENGINEER, UNLESS OTHERWISE NOTED.
- G. CONTRACTOR IS RESPONSIBLE FOR ALL CHARGES RELATED TO SUBMITTAL REVIEW, INCLUDING COURIER AND MAILING CHARGES. CONTRACTOR MUST PROVIDE PRE-PAID AND PRE-ADDRESSED PACKAGING WITH THE SUBMITTAL PACKAGE OR RETRIEVE THE PACKAGE AFTER REVIEW TO FORWARD TO THE APPROPRIATE AGENCY.
- H. PROVIDE BONDING JUMPER GROUND CONNECTION IN ALL BOXES, ENCLOSURES, ETC., FROM THE EQUIPMENT GROUNDING CONDUCTOR.
- I. ALL WIRING DEVICES SHALL BE IDENTIFIED WITH A CLEAR ADHESIVE TYPE LABEL WITH BLACK LETTERS PLACED ON THE WIRING DEVICES' COVER PLATE.
- J. COMMUNICATION CABLES SHALL BE SUPPORTED PER BICSI AND EIA/TIA STRUCTURED CABLING SUPPORTING METHODS AND STANDARD PRACTICES. ALL STRUCTURED CABLING SUPPORTING HARDWARE, MATERIALS, TIE-STRAPS, ETC., SHALL BE PLENUM RATED IN ENVIRONMENTAL RETURN AIR PLENUMS.
- K. CONTRACTOR SHALL COVER ALL INITIATING DEVICES AND NOTIFICATION APPLIANCES TO PREVENT DAMAGE TO DEVICES AND APPLIANCES FROM DIRT AND DUST ACCUMULATION DURING CONSTRUCTION WORK.
- L. COORDINATE WITH THE ARCHITECT, ARCHITECTURAL DRAWING NOTES, DRAWING ELEVATIONS, DRAWING SECTIONS, AND FF&E PACKAGE. SPECIFICATIONS FOR ALL RECEPTACLE AND COMMUNICATION WIRING DEVICES OUTLETS' MOUNTING HEIGHTS AND EXACT MOUNTING LOCATIONS PRIOR TO COMMENCEMENT OF ROUGH-IN WORK.
- M. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY CAVITY HEIGHT AND CLEARANCE, AND TO PROVIDE LIGHTING FIXTURES ACCOMMODATING THE CLEARANCE DIMENSIONS.
- N. CONTRACTOR SHALL COORDINATE INSTALLATION OF ALL LIGHT FIXTURES TO ENSURE THAT THE LIGHT FIXTURES DO NOT INTERFERE WITH ANY STRUCTURAL, MECHANICAL, OR PLUMBING COMPONENTS AND EQUIPMENT. RELOCATE ANY LIGHT FIXTURES DUE TO INTERFERENCES WITH STRUCTURAL, MECHANICAL, OR PLUMBING COMPONENTS AND EQUIPMENT. COORDINATE RELOCATION WITH ARCHITECT.
- O. ALL PENETRATIONS THROUGH SOUND, SECURITY OR FIRE WALLS SHALL BE SLEEVED FOR MECHANICAL PROTECTION. ALL PENETRATIONS AND SLEEVES SHALL BE SEALED WITH CAULKING AND INTUMESCENT MATERIAL (WHERE APPROPRIATE) TO MAINTAIN RESPECTIVE RATINGS OF WALL.
- P. IF REQUESTED, JBA CONSULTING ENGINEERS WILL PROVIDE ELECTRONIC COPY OF THE DIVISION 15 AND 16 SYSTEMS RELATED TO THIS PROJECT FOR THE PURPOSES OF PREPARATION OF SHOP DRAWINGS BY THE CONTRACTOR OR HIS SUB-CONTRACTORS. COPY WILL BE PROVIDED AT A COST OF \$45.00 PER FILE, PAYABLE AT TIME OF ISSUE, AND WITH THE SIGNING OF A DISCLAIMER FOR THE USE OF THE FILE.
- Q. REFER TO DRAWINGS OF OTHER DIVISIONS OF WORK, ESPECIALLY DIVISION 15, FOR LOCATIONS OF EQUIPMENT TO BE CONNECTED OR INTERFACED WITH DIVISION 16.
- R. LOCATE ALL BOXES, FITTINGS, ENCLOSURES, ETC. REQUIRING ACCESS AND DEVICES, ETC. AT NON-ACCESSIBLE CEILINGS, IN ADJACENT AREAS WHERE THERE ARE ACCESSIBLE CEILINGS.
- S. COORDINATE WITH DIVISION 15 FOR INSTALLATION OF SMOKE-HEAT DETECTORS. DO NOT INSTALL DETECTORS WITHIN THREE FEET OF AN AIR SUPPLY GRILL OR DIFFUSER.
- T. PROVIDE A 6" THICK CONCRETE EQUIPMENT PAD UNDER ALL ELECTRICAL ELECTRICAL PANELS THAT ARE FLOOR MOUNTED. PAD TO BE SIZED 3" LARGER ON ALL SIDES THAN THE RESPECTIVE EQUIPMENT FOOTPRINT. CHAMFER EDGES 45 DEGREES.
- U. CONDUITS SHALL NOT BE RUN HORIZONTALLY ON THE ROOF. PENETRATIONS SHALL BE AT EQUIPMENT LOCATIONS ONLY AND SHALL BE COORDINATED WITH DIVISION 15.
- V. KITCHEN APPLIANCES IN LIFE SKILLS CLASSROOM 104 SHALL BE OWNER FURNISHED, CONTRACTOR INSTALLED.

**SYMBOL LIST**

+18"	INDICATES MOUNTING HEIGHTS ARE TO CENTERLINE OF DEVICE ABOVE FINISH FLOOR OR FINISH GRADE	⊕	DUPLEX RECEPTACLE @ +18" UNLESS NOTED
AFF	INDICATES ABOVE FINISHED FLOOR	⊕	GFI RECEPTACLE @ +48" UNLESS NOTED
ATS	INDICATES AUTOMATIC TRANSFER SWITCH	⊕	ELECTRIC CORD REEL
C	INDICATES CONDUIT WITH PULL-LINE ONLY	⊕	CEILING MOUNTED DUPLEX RECEPTACLE
GFCI	INDICATES GROUND FAULT CIRCUIT INTERRUPTER CIRCUITS PROTECTED WITH GFCI SHALL BE PROVIDED WITH DEDICATED NEUTRALS	⊕	COMBINATION POWER TELE/COMM POKE-THRU DEVICE
GFP	INDICATES GROUND FAULT PROTECTION	⊕	JUNCTION BOX
GRND	INDICATES GROUND	⊕	JUNCTION BOX AND SWITCH WITH CONNECTION TO VARIABLE AIR VOLUME BOX. COORDINATE REQUIREMENTS WITH MECHANICAL CONTROL DIAGRAMS
HOA	INDICATES HAND-OFF-AUTO	⊕	NON-FUSED DISCONNECT SWITCH - 30A, 3P, UNLESS NOTED OTHERWISE
NC	INDICATES NORMALLY CLOSED	⊕	FUSED DISCONNECT SWITCH - 30A, 3P WITH 30A FUSES UNLESS NOTED OTHERWISE
NO	INDICATES NORMALLY OPEN	⊕	MAGNETIC MOTOR STARTER - FMR, NEMA SIZE #1 (UNLESS NOTED OTHERWISE) WITH HOA, RED RUN PILOT LIGHT, CONTROL XFMR, SOLID STATE OVERLOADS, (2) NO AND (2) NC CONTACTS
PHL	INDICATES PANEL	⊕	COMBINATION FUSED SWITCH & STARTER AS NOTED ABOVE
WP	INDICATES WEATHER-PROOF (NEMA 3R)	⊕	COMBINATION NON-FUSED SWITCH & STARTER AS NOTED ABOVE
XFMR	INDICATES TRANSFORMER	⊕	RELAY
□	FLUORESCENT FIXTURE	⊕	PHOTOCELL (INSTALL ON ROOF FACING NORTH)
▣	FLUORESCENT FIXTURE WITH INTEGRAL BATTERY BACK-UP	⊕	TELEPHONE OUTLET - STUB 1" WITH PLASTIC END BUSHING INTO ACCESSIBLE CEILING SPACE.
□ <sup>A</sup>	LETTER INDICATES LIGHT FIXTURE TYPE AS INDICATED ON FIXTURE SCHEDULE	⊕	COMBINATION VOICE/DATA COMMUNICATION OUTLET/WALL MOUNTED STUB 1" WITH PLASTIC END BUSHING INTO ACCESSIBLE CEILING SPACE.
□	FLUORESCENT FIXTURE	⊕	SURFACE MOUNTED PANELBOARD
□	FLUORESCENT FIXTURE	⊕	MAIN SWITCHBOARD, MOTOR CONTROL CENTER OR DISTRIBUTION BOARD
□	FLUORESCENT FIXTURE	⊕	TRANSFORMER
○	DOWNLIGHT FIXTURE	⊕	MOTOR OUTLET
⊙	WALL MOUNTED FIXTURE	⊕	HOMERUN TO PANELBOARD WITH NOMENCLATURE (LETTERS), CIRCUIT NUMBERS (NUMBERS), NUMBER OF PHASE AND NEUTRAL CONDUCTORS WHEN MORE THAN TWO (HASH MARKS), NUMBER OF CIRCUITS (NUMBER OF ARROWS).
⊙	EXIT LIGHT WITH DIRECTIONAL ARROWS AS INDICATED CEILING MOUNTED	⊕	CONDUIT AND/OR WIRE CONCEALED IN WALL OR ABOVE CEILING EXCEPT IN EXPOSED STRUCTURE AREAS
⊙	EXIT LIGHT WITH DIRECTIONAL ARROWS AS INDICATED WALL MOUNTED	⊕	CONDUIT AND/OR WIRE BELOW FLOOR OR GRADE
⊙	DOUBLE FACE EXIT LIGHT WITH DIRECTIONAL ARROWS AS INDICATED CEILING MOUNTED	⊕	CONDUIT STUB-OUT
S	SINGLE POLE SWITCH @ +48" UNLESS NOTED	⊕	CONDUIT AND/OR WIRE RISER UP/RISER DOWN
SS	DUAL SWITCH @ +48" UNLESS NOTED	⊕	CIRCUIT BREAKER
S <sub>3</sub>	3-WAY POLE SWITCH @ +48" UNLESS NOTED	⊕	GROUNDING ELECTRODE
S <sub>M</sub>	LOW VOLTAGE DIGITAL MASTER LIGHTING CONTROL SWITCH	⊕	SINGLE METER WITH CT
S <sub>L</sub>	LOW VOLTAGE DIGITAL LIGHTING CONTROL SWITCH	⊕	FEEDER - SIZE AS INDICATED ON FEEDER SCHEDULE
S <sub>T</sub>	THERMAL OVERLOAD SWITCH	⊕	DIVISION 15 EQUIPMENT - SEE HVAC AND PLUMBING DRAWINGS
[SD]	SMOKE DETECTOR	⊕	TRANSIENT VOLTAGE SURGE SUPPRESSOR
[HD]	HEAT DETECTOR	⊕	GROUND BUS & GROUND ELECTRODES
[DD]	DUCT DETECTOR	⊕	SPECIFIC NOTE
[FA]	FIRE ALARM MANUAL PULLSTATION @ +48" AFF	⊕	
[FS]	FLOW SWITCH	⊕	
[TS]	TAMPER SWITCH	⊕	
[FM]	FIRE ALARM MONITOR MODULE	⊕	
[C]	COMBINATION FLUSH MOUNTED DIGITAL CLOCK/INTERCOM SPEAKER WITH CALL-IN SWITCH	⊕	
[C]	FLUSH MOUNTED DIGITAL CLOCK	⊕	
[C]	RECESSED CEILING MOUNTED P/A SPEAKER WITH BACKBOX	⊕	
[C]	SURFACE MOUNTED WEATHERPROOF P/A HORN SPEAKER WITH WIRE GUARD	⊕	


**LIGHTING FIXTURE SCHEDULE**

TYPE	WATTS	LAMPS	MANUFACTURER AND LUMINAIRE TYPE AND/OR DESCRIPTION	VOLTAGE
A	88	(3) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-332-18D-1VOLT-GE810S OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
AE	88	(3) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-332-18D-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
B	58	(2) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-332-12D-1VOLT-GE810S OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
BE	58	(2) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-332-12D-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
C	53	(2) PHILIPS F316T8/U-BENT	UTRONA #2942-G-B-20316-18D-1VOLT-GE810S OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
CE	53	(2) PHILIPS F316T8/U-BENT	UTRONA #2942-G-B-20316-18D-1VOLT-GE810S-EL OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
D	88	(3) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-332-RW-A12125-1VOLT-1/3-GE810S OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
DE	88	(3) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-332-RW-A12125-1VOLT-1/3-GE810S-EL OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
F	53	(2) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-232-RW-A12125-1VOLT-GE810S OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
FE	53	(2) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-232-RW-A12125-1VOLT-GE810S-EL OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
G	58	(2) PHILIPS /ADVB30/XEW/ALTO	UTRONA #2942-G-20316-RW-A12125-1VOLT-GE810S OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
GE	58	(2) PHILIPS /ADVB30/XEW/ALTO	UTRONA #2942-G-20316-RW-A12125-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
H	70	(2) PHILIPS PL-T 32W/830/4P/ALTO	UTRONA #2942-G-20316-RW-A12125-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
JE	53	(2) PHILIPS F32T8/ADVB30/XEW/ALTO	UTRONA #2942-G-B-232-RW-A12125-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	1VOLT
K	170	150W PSMH	UTRONA #2942-G-B-232-RW-A12125-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	277
L	65	50W MH	UTRONA #2942-G-B-232-RW-A12125-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	277
M	5	LED	UTRONA #2942-G-B-232-RW-A12125-1VOLT-GE810S-EL14 OR APPROVED EQUIVALENT BY LIGHTOLIER, DAYBRITE, H.F. WILLIAMS OR METALUX	120/277

- NOTES:**
- ALL LAMPS SHALL HAVE A COLOR RENDERING INDEX (CRI) OF GREATER THAN 80.
  - "a" & "b" SUBSCRIPT LETTER OR SUPERSCRIPIT LETTER, ETC., IN FIXTURE SYMBOL OR ON TOGGLE SWITCHES INDICATES SWITCHING GROUP.
  - PROVIDE MANUFACTURER'S HARDWARE AND APPURTENANCES WITH THE LUMINAIRE FOR A COMPLETE ELECTRICAL INSTALLATION THIS INCLUDES BUT DOES NOT NECESSARILY LIMIT TO: CONDUIT, CONDUIT BODIES, SPACERS, HANGERS, STEM RODS, SCREWS, CLIPS AND MISCELLANEOUS MOUNTING ACCESSORIES.
  - AREAS INDICATED FOR DUAL SWITCHING SHALL BE SWITCHED AS FOLLOWS: ONE SWITCH SHALL OPERATE THE OUTER LAMPS AND THE SECOND SWITCH SHALL OPERATE THE INNER LAMPS. PROVIDE ALL BALLASTS, FIXTURE WHIPS, ETC. AS REQUIRED FOR A COMPLETE INSTALLATION.
  - ALL EXIT SIGN AND EMERGENCY LIGHTING FIXTURES SHALL BE CONNECTED TO AN UN-SWITCHED PHASE LEG OF THE LIGHTING BRANCH CIRCUIT PROVIDING ELECTRICAL POWER SERVICE TO THE AREA, ROOM OR SPACE. PROVIDE ADDITIONAL CONDUCTORS TO ACCOMMODATE.
  - EMERGENCY LIGHTING FIXTURES SHALL BE WIRED FOR SWITCHED OPERATION UNLESS OTHERWISE NOTED. EXIT LIGHTS SHALL BE UNSWITCHED.
  - ALL LINEAR FLUORESCENT 4'-0" OR TANDEM 8'-0" LIGHT FIXTURES SHALL BE INSTALLED WITH MANUFACTURER'S HARDWARE AND SUSPENDED FROM THE CEILING STRUCTURE OR OTHER STRUCTURAL MEMBERS TO BE PROVIDED BY THE DIVISION 16 CONTRACTOR AS REQUIRED.
  - CONTRACTOR SHALL VERIFY AND PROVIDE IF RECESSED LIGHT FIXTURES REQUIRE AN IC OR NON-IC RATING.
  - COORDINATE MOUNTING LOCATION, POSITION, ORIENTATIONS, ETC., OF ALL LIGHT FIXTURES WITH ARCHITECT. COORDINATE COLORS OF ALL SWITCH DEVICES AND PLATES WITH ARCHITECT.
  - FURNISH AND INSTALL ALL MOUNTING HARDWARE AND ACCESSORIES PER THE MANUFACTURER'S CATALOG FOR EACH AND EVERY TYPE OF LIGHT FIXTURE DELINEATED IN THE LIGHT FIXTURE SCHEDULE FOR A COMPLETE WORKING INSTALLATION. NO LIGHT FIXTURE, ETC., MOUNTED ON AN EXTERIOR WALL SHALL DAMAGE THE WALL MATERIAL AND CAUSE MOISTURE INTRUSION. PROPERLY SEAL ALL EXTERIOR WALL PENETRATIONS WITH AN APPROVED SEALANT U.L. LISTED FOR THE APPLICATIONS.
  - PROVIDE ALL NECESSARY AND REQUIRED POLE, FIXTURES, MOUNTING AND SUPPORT HARDWARE, FOUNDATION, RE-INFORCING STEEL, LAMPS, ANCHORING, FREIGHT, HANDLING, ETC.
  - NO LIGHT FIXTURE, EXIT SIGN OR UNIT EQUIPMENT SHALL BE ORDERED WITHOUT SUBMITTAL APPROVALS FROM THE ARCHITECT AND ENGINEER.
  - PROVIDE DIMMING BALLAST WHERE REQUIRED BY OTHER DETAILS, NOTES ON LIGHTING PLAN.

**SHEET INDEX**

ISSUE	SHEET NUMBER	SHEET DESCRIPTION
	E0.00	LEGEND, SHEET INDEX AND FIXTURE SCHEDULE
	E1.00	SITE ELECTRICAL PLAN
	E1.01	CANOPY LIGHTING PLANS
	E1.02	FIRST FLOOR LIGHTING PLAN
	E1.03	SECOND FLOOR LIGHTING PLAN
	E1.04	MEZZANINE LIGHTING PLAN
	E2.00	FIRST FLOOR POWER PLAN
	E2.01	SECOND FLOOR POWER PLAN
	E2.02	MEZZANINE POWER PLAN
	E3.00	FIRST FLOOR SPECIAL SYSTEMS PLAN
	E3.01	SECOND FLOOR SPECIAL SYSTEMS PLAN
	E3.02	MEZZANINE SPECIAL SYSTEMS PLAN
	E4.00	ENLARGED PLANS AND DETAILS
	E4.01	DIAGRAMS AND DETAILS
	E4.02	DIAGRAMS AND DETAILS
	E4.03	DIAGRAMS AND DETAILS
	E5.00	SINGLE LINE DIAGRAM AND SCHEDULES
	E6.00	PANEL SCHEDULES

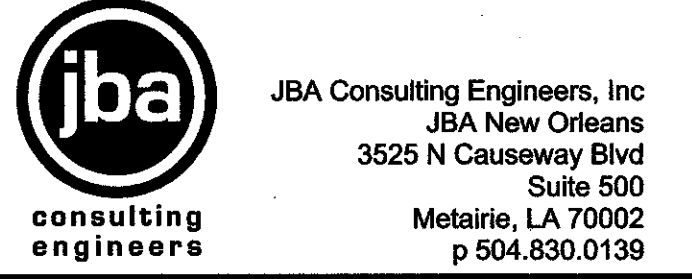

no.	revisions	date
1		
2		
3		
4		
5		
6		

**HARRY HURST MIDDLE SCHOOL WING ADDITION**  
 1 Roadrunner Lane, Destrehan, Louisiana 70047  
 LEGEND, SHEET INDEX AND FIXTURE SCHEDULE

STATE OF LOUISIANA  
 ALVIN L. PHELPS, JR.  
 License No. 24002  
 PROFESSIONAL ENGINEER  
 IN  
 ELECTRICAL ENGINEERING

MURRAY ARCHITECTS  
 drawing number  
 project number 10.0123  
 date 06.14.2010  
 phase CD

**E0.00**

THESE DOCUMENTS ARE PROTECTED BY UNITED STATES COPYRIGHT LAW. THEY HAVE BEEN PREPARED SPECIFICALLY FOR THE EXCLUSIVE USE OF THE CLIENT AND ARE NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE EXPRESS WRITTEN PERMISSION OF MURRAY ARCHITECTS. ANY UNAUTHORIZED REPRODUCTION OR TRANSMISSION OF THESE DOCUMENTS WILL BE PROSECUTED TO THE FULL EXTENT OF THE LAW. ALL RIGHTS ARE RESERVED TO MURRAY ARCHITECTS.