

**PARTITION GENERAL NOTES**

1. ALL GYPSUM WALL BOARD (GWB) SHALL BE TYPE "X". SEE FINISH SCHEDULE.
2. PROVIDE 5/8" CEMENTITIOUS BOARD FOR PARTITIONS WHERE CERAMIC TILE IS SHOWN U.O.N.; SEE FINISH SCHEDULE AND PLAN.
3. PROVIDE 5/8" MOISTURE-RESISTANT GYP. BD. IN LIEU OF REGULAR GYP. BD. WHERE CALLED FOR. SEE FINISH SCHEDULE.
4. REFER TO STRUCTURAL DRAWINGS FOR FURTHER INFO REGARDING ALL BEARING WALLS.
5. REFER TO FLOOR PLANS FOR PARTITION TYPE DESIGNATIONS AND LOCATIONS.
6. ALL STEEL STUDS SHALL BE MIN. 20 GAUGE U.O.N.; ALL STEEL TRACK RUNNERS AND DEFLECTION CLIPS SHALL BE SAME CALICE. SEE PARTITION TYPES; SEE STRUCTURAL DWGS. FOR STUD SIZES AND GAUGES AT ALL BEARING WALL CONDITIONS.
7. PROVIDE ACOUSTICAL SEALANT AND FILL S.A.B. MATERIALS AS REQUIRED AT TOP AND BOTTOM OF ALL ACOUSTICALLY RATED PARTITIONS. U.O.N.; SEAL ALL PENETRATIONS IN ACOUSTICALLY RATED PARTITIONS.
8. STEEL RUNNERS AT GWB HEADS SHALL BE DEEP LEG U.O.N.
9. PROVIDE U.L. CLASSIFIED JOINT SEALANT, FILL MATERIALS FOR ALL FIRE-RATED PARTITIONS.
10. PROVIDE CONTROL JOINTS IN GWB PARTITIONS @ 30'-0" O.C. MAX. HORIZONTALLY. ALSO, PROVIDE CONTROL JOINTS IN GWB CEILINGS @ 50'-0" MAX. O.C. IN EACH DIRECTION; SEE INTERIOR ELEVATIONS FOR LOCATION OF CONTROL JOINTS.
11. PROVIDE MINIMUM 3 1/2" THICK SOUND ATTENUATION BLANKET (S.A.B.) WHERE REQUIRED.

**REGIONAL DESIGN GROUP, LLC**  
 300 LAFAYETTE STREET, SUITE 200  
 NEW ORLEANS, LOUISIANA 70130  
 (504) 523-6472 FAX (504) 529-1181

**STUELLER  
 THOMPSON  
 BROWN  
 ARCHITECTS**


NO.	REVISIONS
1	REVISION
2	
3	
4	
5	

**JEFFERSON PARISH SHERIFFS OFFICE**  
**4TH DISTRICT SUBSTATION**  
 6228 AIRLINE DRIVE METAIRIE, LOUISIANA 70003

**PARTITION TYPES**

file name	A901.dwg	drawing number	
project number	51122.03		
date	02-25-10		
phase	CD		


**A901**

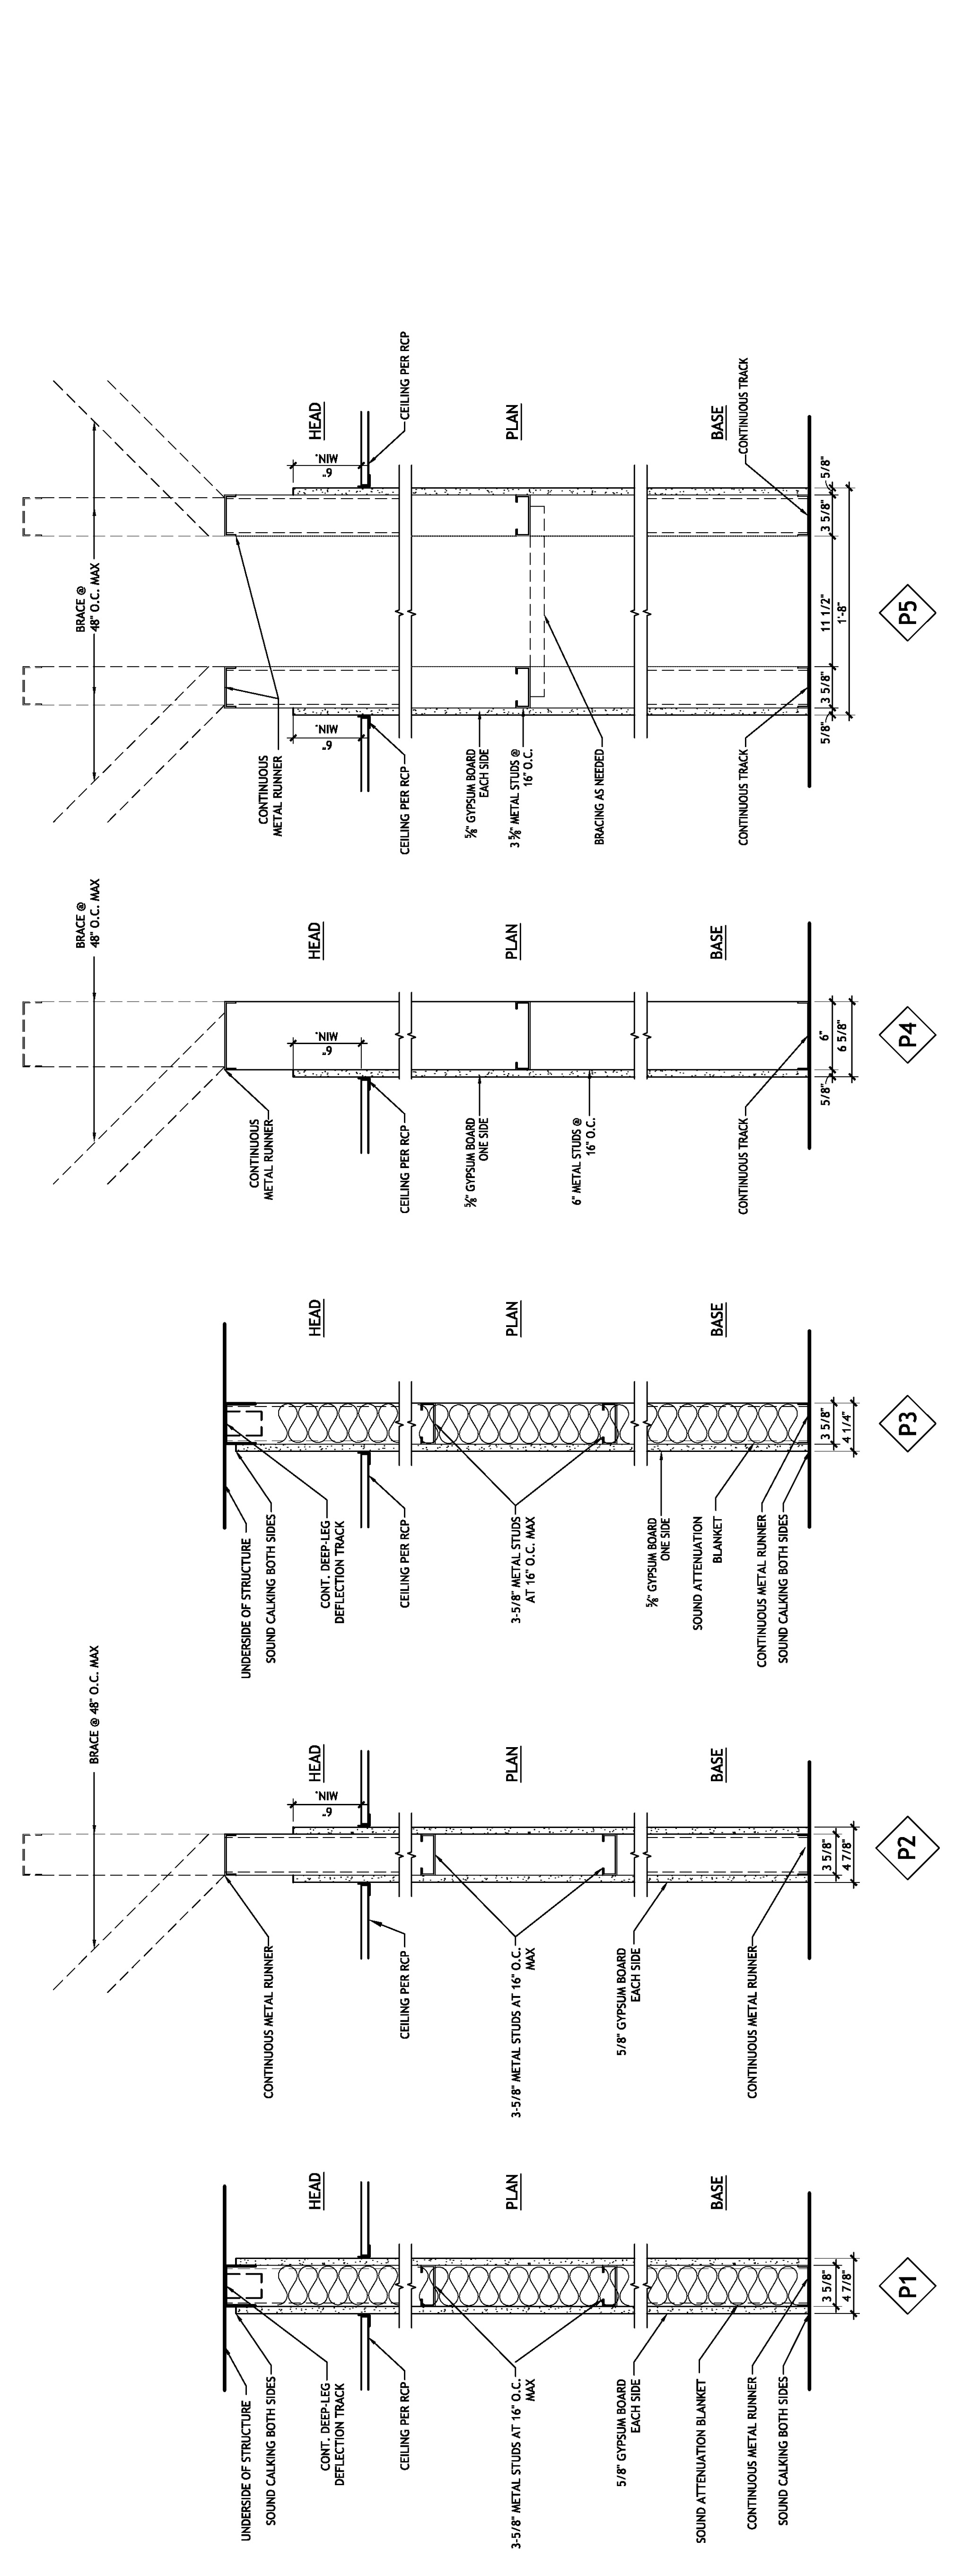

**P3** SMOKE PARTITIONS: CONSTRUCTED TO LIMIT THE TRANSFER OF SMOKE

**P12** - 1 HOUR FIRE RATED UL# U465 WERE INDICATED ON FLOOR PLANS

**P15** SMOKE PARTITIONS: CONSTRUCTED TO LIMIT THE TRANSFER OF SMOKE

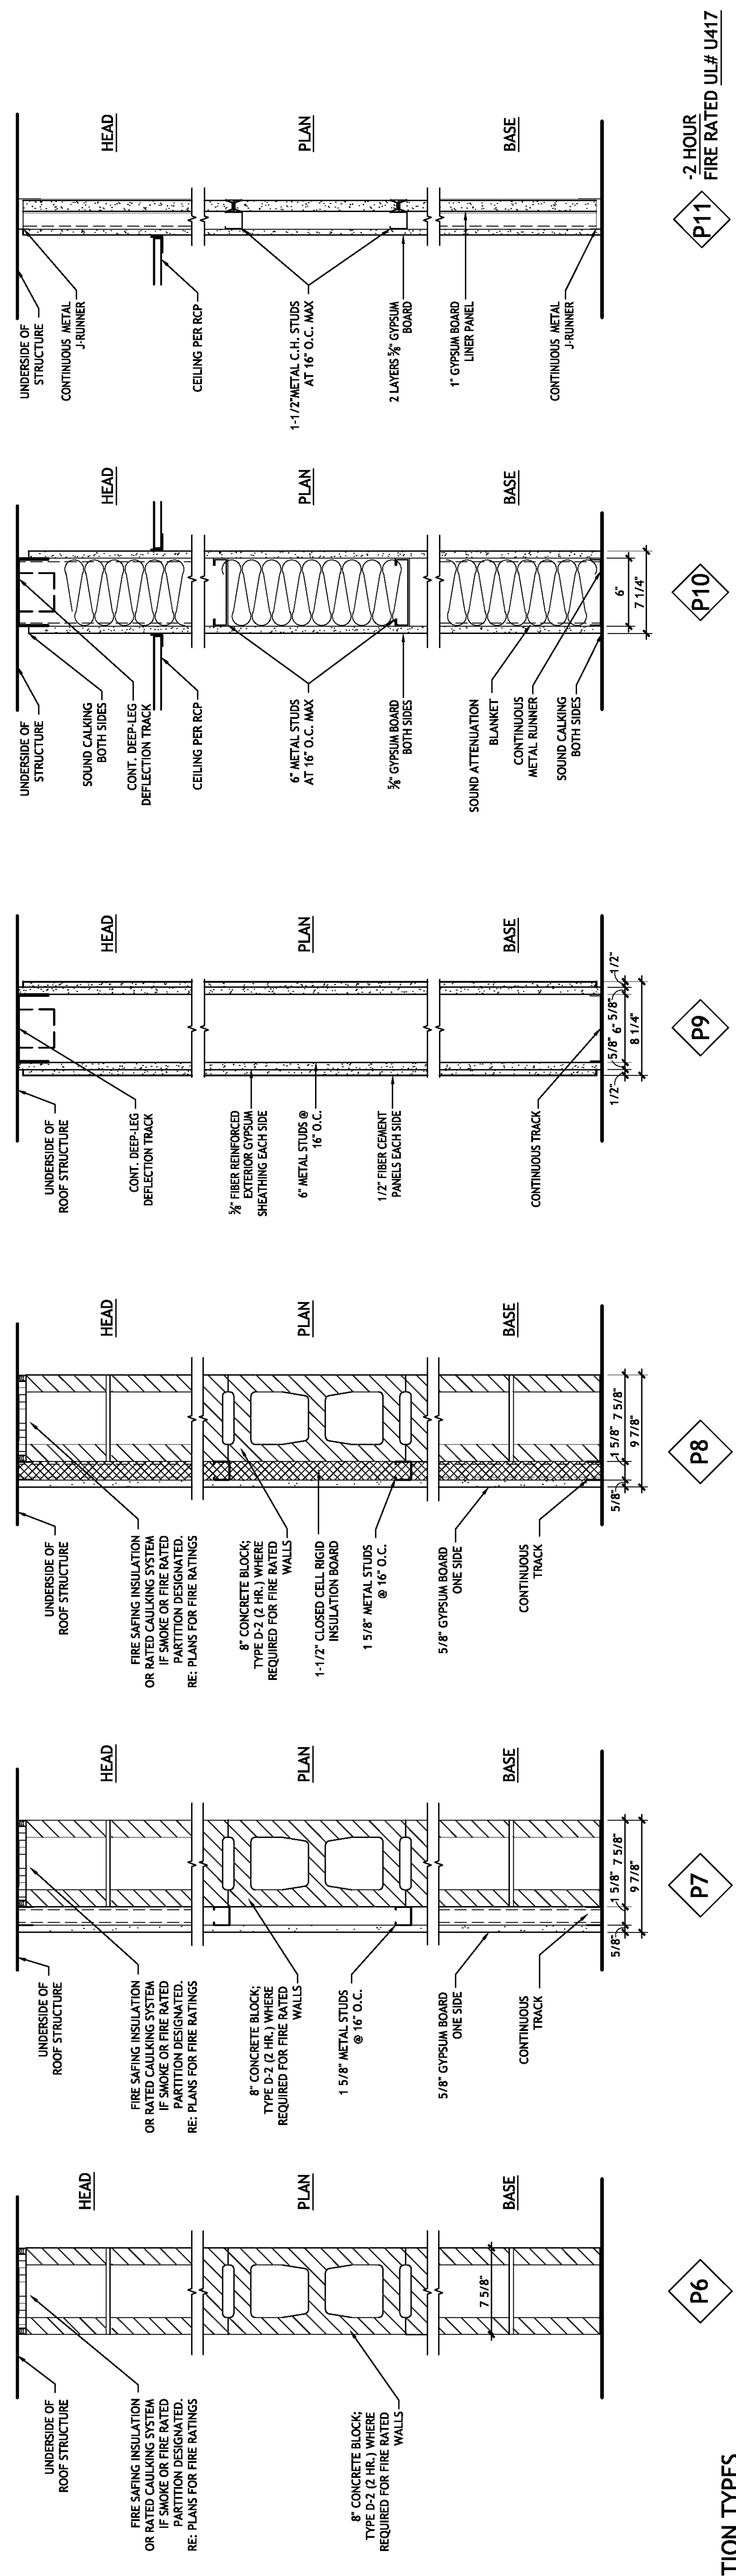

**1 PARTITION TYPES**  
 A901 1/2"=1'-0"